DATASHEET - NZMH1-4-A80



Circuit-breaker, 4p, 80A

Part no. NZMH1-4-A80 Catalog No. 284428

EL-Nummer (Norway)

4363462



Construction size



Product range Protective function Standard/Approval Installation type Release system Circuit-breaker System and cable protection IEC Installation type Fixed Thermomagnetic release

Description Set value in neutral conductor is synchronous with set value Ir of main pole.

NZM1

Number of poles 4 pole

Standard equipment Box terminal

Switching capacity

Rated current = rated uninterrupted current $I_n = I_u$ A 80 Neutral conductor % of phase % 100

Neutral conductor % of phase % 10 conductor

Setting range

Overload trip I_r A 63 - 80

Main pole I_r A 63 - 80

中

Short-circuit releases

Non-delayed $I_i = I_n \times ...$ 6 -

Short-circuit releases I_{rm} A 480 - 800

6 - 10

480 - 800

Technical data

1>

General		
Standards		IEC/EN 60947
Protection against direct contact		Finger and back of hand proof to VDE 0106 Part 100
Climatic proofing		Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30
Ambient temperature		
Ambient temperature, storage	°C	- 40 - + 70
Operation	°C	-25 - +70
Mechanical shock resistance (10 ms half-sinusoidal shock) according to IEC 60068-2-27	g	20 (half-sinusoidal shock 20 ms)
Safe isolation to EN 61140		
Between auxiliary contacts and main contacts	V AC	500

hat was a the auxiliary contacts		V AC	200
between the auxiliary contacts		V AC	300
Mounting position			Vertical and 90° in all directions With XFI earth-fault release: - NZM1, N1, NZM2, N2: vertical and 90° in all directions with plug-in unit - NZM1, N1, NZM2, N2: vertical, 90° right/left with withdrawable unit: - NZM3, N3: vertical, 90° right/left - NZM4, N4: vertical with remote operator: - NZM2, N(S)2, NZM3, N(S)3, NZM4, N(S)4: vertical and 90° in all directions
Direction of incoming supply			as required
Degree of protection			
Device			In the operating controls area: IP20 (basic degree of protection)
Enclosures			With insulating surround: IP40 With door coupling rotary handle: IP66
Terminations			Tunnel terminal: IP10 Phase isolator and strip terminal: IP00
Other technical data (sheet catalogue)			Temperature dependency, Derating
Circuit-breakers Rated current = rated uninterrupted current	1 -1	Α	80
	I _n = I _u	A	00
Rated surge voltage invariability	U _{imp}	V	2000
Main contacts		V	6000
Auxiliary contacts			6000
Rated operational voltage	U _e	V AC	690
Overvoltage category/pollution degree Rated insulation voltage	11.	V	III/3 690
	Ui		
Use in unearthed supply systems Switching capacity		V	≦ 690
Rated short-circuit making capacity	I _{cm}		
240 V	I _{cm}	kA	220
400/415 V	I _{cm}	kA	220
440 V 50/60 Hz	I _{cm}	kA	74
525 V 50/60 Hz	I _{cm}	kA	40
690 V 50/60 H	Ic	kA	17
Rated short-circuit breaking capacity I _{cn}	I _{cn}	10 1	
Icu to IEC/EN 60947 test cycle 0-t-C0	lcu	kA	
240 V 50/60 Hz	I _{cu}	kA	100
400/415 V 50/60 Hz	I _{cu}	kA	100
440 V 50/60 Hz		kA	70
525 V 50/60 Hz	I _{cu}	kA	20
690 V 50/60 Hz	I _{cu}	kA	10
lcs to IEC/EN 60947 test cycle 0-t-C0-t-C0	l _{cu}	kA	
10s to 1EL/EN 60947 test cycle 0-t-C0-t-C0 240 V 50/60 Hz	I _{cs}	kA kA	100
400/415 V 50/60 Hz		kA	50
440 V 50/60 Hz	I _{cs}	kA	35
525 V 50/60 Hz	I _{cs}	kA	10
690 V 50/60 Hz		kA	7.5
200 4 30/00 112	I _{cs}	NA.	Maximum back-up fuse, if the expected short-circuit currents at the installation location exceed the switching capacity of the circuit-breaker.
Utilization category to IEC/EN 60947-2			A
Lifespan, mechanical(of which max. 50 % trip by shunt/undervoltage release)	Operations		20000
Lifespan, electrical			
AC-1			
400 V 50/60 Hz	Operations		10000
415 V 50/60 Hz	Operations		10000

690 V 50/60 Hz	Operations		7500
Max. operating frequency		Ops/h	120
Total break time at short-circuit		ms	< 10
Terminal capacity			
Standard equipment			Box terminal
Optional accessories			Screw connection Tunnel terminal connection on rear
Round copper conductor			
Box terminal			
Solid		mm ²	1 x (10 - 16) 2 x (6 - 16)
Stranded		mm ²	$1 \times (10 - 70)^{3}$ $2 \times (6-25)$ 3) Up to 95 mm ² can be connected depending on the cable manufacturer.
Tunnel terminal			,
Solid		mm ²	1 x 16
Stranded		111111	
1-hole		2	1 x (25 - 95)
		mm ²	1 A 120 001
Bolt terminal and rear-side connection			
Direct on the switch			4 40 40
Solid		mm ²	1 x (10 - 16) 2 x (6 - 16)
Stranded		mm ²	1 x (10 - 70) ³⁾ 2 x 25
			³⁾ Up to 95 mm ² can be connected depending on the cable manufacturer.
Al circular conductor			
Tunnel terminal			
Solid		mm^2	1 x 16
Stranded			
Stranded		mm ²	1 x (25 - 95)
Bolt terminal and rear-side connection			
Direct on the switch			
Solid		mm ²	1 x (10 - 16) 2 x (10 - 16)
Stranded		mm ²	1 x (25 - 35) 2 x (25 - 35)
Cu strip (number of segments x width x segment thickness)			
Box terminal			
	min.	mm	2 x 9 x 0.8
	max.	mm	9 x 9 x 0.8
Copper busbar (width x thickness)	mm		
Bolt terminal and rear-side connection			
Screw connection			M6
Direct on the switch			
	min.	mm	12 x 5
	max.	mm	16 x 5
Control cables			
		mm ²	1 x (0.75 - 2.5) 2 x (0.75 - 1.5)

Design verification as per IEC/EN 61439

Technical data for design verification			
Rated operational current for specified heat dissipation	In	Α	80
Equipment heat dissipation, current-dependent	P _{vid}	W	16.32
Operating ambient temperature min.		°C	-25
Operating ambient temperature max.		°C	70
IEC/EN 61439 design verification			

10.2 Strength of materials and parts	
10.2.2 Corrosion resistance	Meets the product standard's requirements.
10.2.3.1 Verification of thermal stability of enclosures	Meets the product standard's requirements.
10.2.3.2 Verification of resistance of insulating materials to normal heat	Meets the product standard's requirements.
10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects	Meets the product standard's requirements.
10.2.4 Resistance to ultra-violet (UV) radiation	Meets the product standard's requirements.
10.2.5 Lifting	Does not apply, since the entire switchgear needs to be evaluated.
10.2.6 Mechanical impact	Does not apply, since the entire switchgear needs to be evaluated.
10.2.7 Inscriptions	Meets the product standard's requirements.
10.3 Degree of protection of ASSEMBLIES	Does not apply, since the entire switchgear needs to be evaluated.
0.4 Clearances and creepage distances	Meets the product standard's requirements.
0.5 Protection against electric shock	Does not apply, since the entire switchgear needs to be evaluated.
0.6 Incorporation of switching devices and components	Does not apply, since the entire switchgear needs to be evaluated.
0.7 Internal electrical circuits and connections	Is the panel builder's responsibility.
0.8 Connections for external conductors	Is the panel builder's responsibility.
0.9 Insulation properties	
10.9.2 Power-frequency electric strength	Is the panel builder's responsibility.
10.9.3 Impulse withstand voltage	Is the panel builder's responsibility.
10.9.4 Testing of enclosures made of insulating material	Is the panel builder's responsibility.
0.10 Temperature rise	The panel builder is responsible for the temperature rise calculation. Eaton wi provide heat dissipation data for the devices.
0.11 Short-circuit rating	Is the panel builder's responsibility. The specifications for the switchgear mus observed.
0.12 Electromagnetic compatibility	Is the panel builder's responsibility. The specifications for the switchgear mus observed.
10.13 Mechanical function	The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.


Technical data ETIM 7.0


Low-voltage industrial components (EG000017) / Power circuit-breaker for trafo/generator/installation protection (EC000228)


Electric engineering, automation, process control engineering / Low-voltage switch technology / Circuit breaker (LV < 1 kV) / Circuit breaker for power transformer, generator and system protection (ecl@ss10.0.1-27-37-04-09 [AJZ716013])

Overload release current setting A 63 - 80 Adjustment range short-term delayed short-circuit release Adjustment range undelayed short-circuit release A 6 - 10 Integrated earth fault protection Type of electrical connection of main circuit Device construction Suitable for DIN rail (top hat rail) mounting DIN rail (top hat rail) mounting DIN rail (top hat rail) mounting Ostional Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally open contact Number of auxiliary contacts as change-over contact With switched-off indicator With switched-off indicator Number of poles Number of poles Number of connection for main current circuit Type of control element Complete device with protection unit Motor drive integrated No	protection (ecl@ss10.0.1-27-37-04-09 [AJZ716013])		
Rated short-circuit breaking capacity lou at 400 V, 50 Hz Overload release current setting A	Rated permanent current lu	Α	80
Overload release current setting A 63 - 80 Adjustment range short-term delayed short-circuit release A 0 - 0 Adjustment range undelayed short-circuit release A 6 - 10 Adjustment range undelayed short-circuit release A 6 - 10 Integrated earth fault protection No Frame clamp Device construction Built-in device fixed built-in technique Suitable for DIN rail (top hat rail) mounting No Yes Number of auxiliary contacts as normally closed contact Yes 0 Number of auxiliary contacts as change-over contact O 0 With switched-off indicator No No With under voltage release No No Number of poles 4 4 Position of connection for main current circuit Front side Front side Type of control element Rocker lever Rocker lever Complete device with protection unit Yes No Motor drive integrated No No	Rated voltage	V	690 - 690
Adjustment range short-term delayed short-circuit release Adjustment range undelayed short-circuit release A 6 - 10 No Type of electrical connection of main circuit Device construction Built-in device fixed built-in technique Built-in device fixed built-in technique DIN rail (top hat rail) mounting DIN rail (top hat rail) mounting optional No No No Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally open contact Number of auxiliary contacts as change-over contact No No With switched-off indicator No With under voltage release No Number of poles A 6 - 10 No	Rated short-circuit breaking capacity Icu at 400 V, 50 Hz	kA	100
Adjustment range undelayed short-circuit release Integrated earth fault protection Type of electrical connection of main circuit Device construction Suitable for DIN rail (top hat rail) mounting Suitable for DIN rail (top hat rail) mounting DIN rail (top hat rail) mounting optional Suitable for DIN rail (top hat rail) mounting optional Sui	Overload release current setting	Α	63 - 80
Integrated earth fault protection Type of electrical connection of main circuit Device construction Suitable for DIN rail (top hat rail) mounting DIN rail (top hat rail) mounting optional Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally open contact Number of auxiliary contacts as change-over contact Number of auxiliary contacts as change-over contact Number of poles Number of poles Number of poles Number of connection for main current circuit Type of control element Complete device with protection unit Motor drive integrated Motor drive optional No	Adjustment range short-term delayed short-circuit release	Α	0 - 0
Type of electrical connection of main circuit Device construction Suitable for DIN rail (top hat rail) mounting DIN rail (top hat rail) mounting optional No DIN rail (top hat rail) mounting optional Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally open contact Number of auxiliary contacts as change-over contact Number of auxiliary contacts as change-over contact No With switched-off indicator With under voltage release No No Number of poles Position of connection for main current circuit Type of control element Complete device with protection unit Motor drive integrated Motor drive optional	Adjustment range undelayed short-circuit release	Α	6 - 10
Device construction Suitable for DIN rail (top hat rail) mounting DIN rail (top hat rail) mounting optional Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally open contact Number of auxiliary contacts as change-over contact Number of poss With switched-off indicator No No No No No No No No No	Integrated earth fault protection		No
Suitable for DIN rail (top hat rail) mounting DIN rail (top hat rail) mounting optional Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally open contact Number of auxiliary contacts as change-over contact Number of auxiliary contacts as change-over contact Number of auxiliary contacts as change-over contact Number of pauxiliary contacts as change-over contact Number of pidicator No No No Number of poles No	Type of electrical connection of main circuit		Frame clamp
DIN rail (top hat rail) mounting optional Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally open contact Number of auxiliary contacts as change-over contact Number of auxiliary contacts as change-over contact No With switched-off indicator With under voltage release No Number of poles Position of connection for main current circuit Type of control element Complete device with protection unit Motor drive integrated Motor drive optional	Device construction		Built-in device fixed built-in technique
Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally open contact Number of auxiliary contacts as change-over contact Number of auxiliary contacts as change-over contact No With switched-off indicator With under voltage release No No Number of poles A Position of connection for main current circuit Type of control element Complete device with protection unit Motor drive integrated Motor drive optional O O No No No No No No No No	Suitable for DIN rail (top hat rail) mounting		No
Number of auxiliary contacts as normally open contact Number of auxiliary contacts as change-over contact No With switched-off indicator With under voltage release No Number of poles A Position of connection for main current circuit Type of control element Complete device with protection unit Motor drive integrated No No Number of auxiliary contacts as normally open contact O O O O O O O O O O O O O	DIN rail (top hat rail) mounting optional		Yes
Number of auxiliary contacts as change-over contact With switched-off indicator With under voltage release No Number of poles Position of connection for main current circuit Type of control element Complete device with protection unit Motor drive integrated Motor drive optional O O O O O O O O O O O O O	Number of auxiliary contacts as normally closed contact		0
With switched-off indicator With under voltage release No Number of poles Position of connection for main current circuit Type of control element Complete device with protection unit Motor drive integrated Motor drive optional No No No No No No No No No N	Number of auxiliary contacts as normally open contact		0
With under voltage release No Number of poles 4 Position of connection for main current circuit Type of control element Complete device with protection unit Motor drive optional No	Number of auxiliary contacts as change-over contact		0
Number of poles A position of connection for main current circuit Type of control element Complete device with protection unit Motor drive optional A position of connection for main current circuit Front side Rocker lever Rocker lever Yes No No No	With switched-off indicator		No
Position of connection for main current circuit Type of control element Complete device with protection unit Motor drive optional Front side Rocker lever Yes No No	With under voltage release		No
Type of control element Complete device with protection unit Motor drive optional Rocker lever Yes No No	Number of poles		4
Complete device with protection unit Yes Motor drive integrated Motor drive optional No	Position of connection for main current circuit		Front side
Motor drive integrated No	Type of control element		Rocker lever
Motor drive optional No	Complete device with protection unit		Yes
·	Motor drive integrated		No
Degree of protection (IP) IP20	Motor drive optional		No
	Degree of protection (IP)		IP20


Characteristics

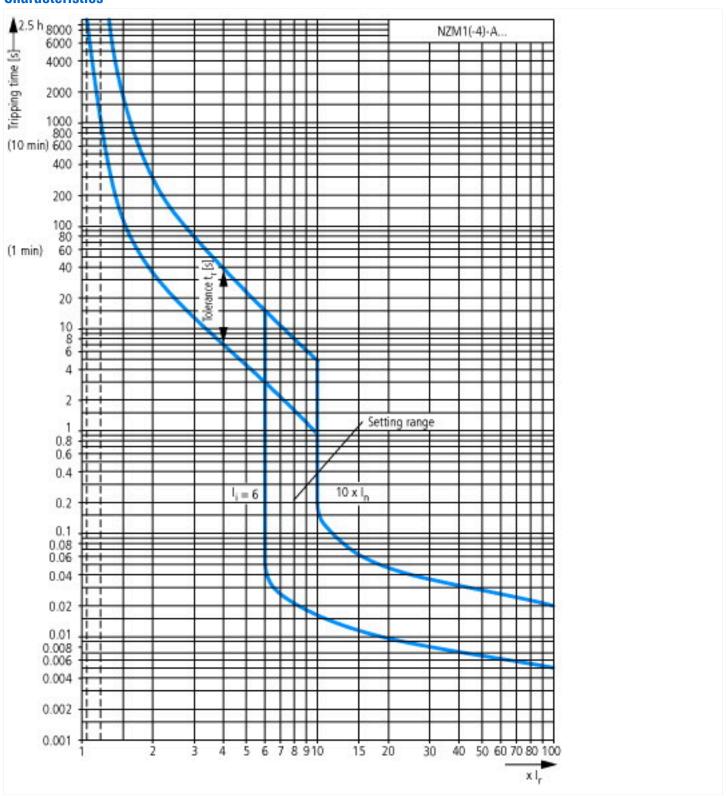


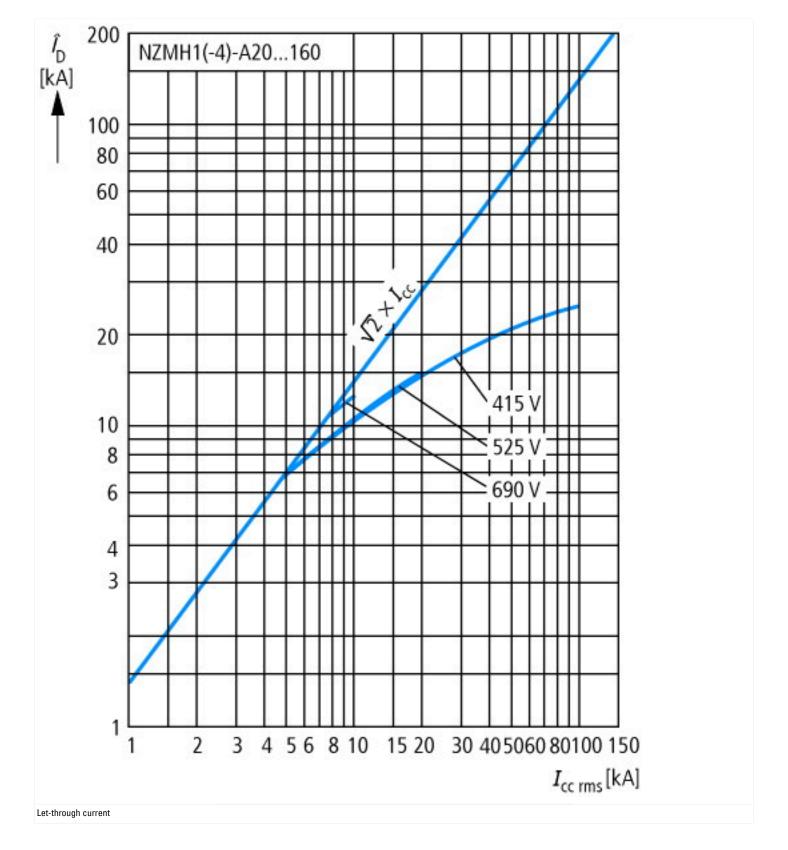

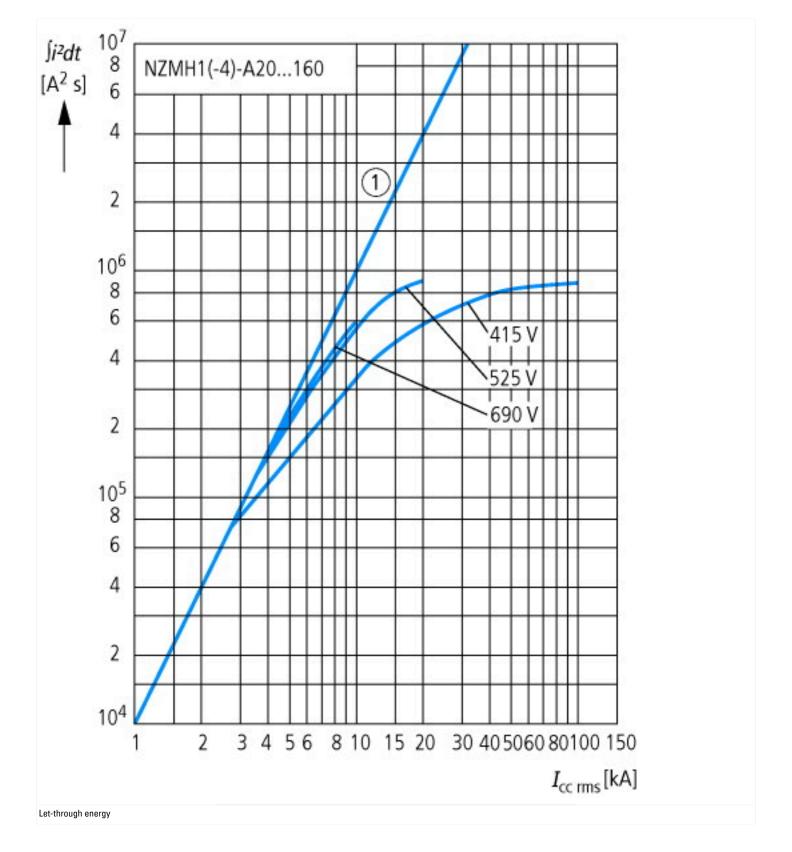

Dimensions

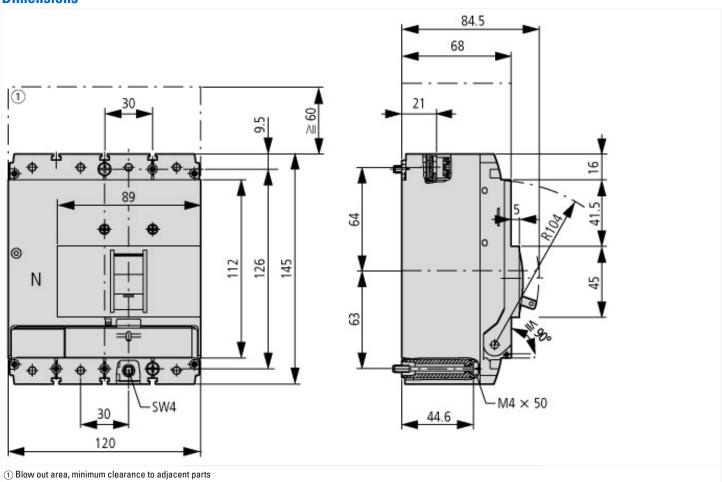

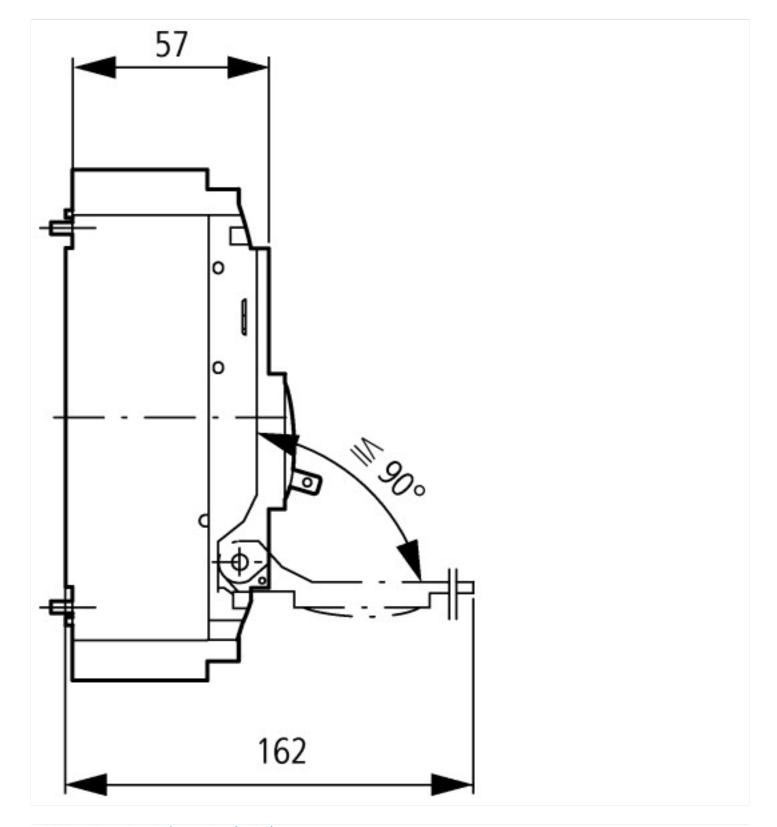

Additional product information (links)

IL01203004Z (AWA1230-1913) Circuit-breaker, Switch-Disconnector		
IL01203004Z (AWA1230-1913) Circuit-breaker, Switch-Disconnector	https://es-assets.eaton.com/DOCUMENTATION/AWA_INSTRUCTIONS/IL01203004Z2015_11.pdf	
Temperature dependency, Derating	http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.172	
CurveSelect characteristics program	http://www.eaton.eu/DE/Europe/Electrical/CustomerSupport/ConfigurationTools/CharacteristicsProgram/index.htm	
additional technical information for NZM power switch	https://es-assets.eaton.com/DOCUMENTATION/PDF/nzm_technic_de_en.pdf	