### **DATASHEET - NZMN1-4-A40**



Circuit-breaker, 4p, 40A

Part no. NZMN1-4-A40 Catalog No. 265811

EL-Nummer (Norway) 0004358821





Delivery program			
Product range			Circuit-breaker
Protective function			System and cable protection
Standard/Approval			IEC
Installation type			Fixed
Release system			Thermomagnetic release
Construction size			NZM1
Description			Set value in neutral conductor is synchronous with set value Ir of main pole.
Number of poles			4 pole
Standard equipment			Box terminal
Switching capacity			
400/415 V 50 Hz	I <sub>cu</sub>	kA	50
Rated current = rated uninterrupted current			
Rated current = rated uninterrupted current	$I_n = I_u$	Α	40
Neutral conductor	% of phase conductor	CSA	100
Setting range			
Overload trip			
中	l <sub>r</sub>	Α	32 - 40
Main pole	I <sub>r</sub>	A	32 - 40
Short-circuit releases			
Non-delayed	$I_i = I_n \times \dots$		8 - 10
Short-circuit releases	I <sub>rm</sub>	Α	320 - 400

## **Technical data**

	IEC/EN 60947
	Finger and back of hand proof to VDE 0106 Part 100
	Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30
°C	- 40 - + 70
°C	-25 - +70
g	20 (half-sinusoidal shock 20 ms)
V A	C 500
	g °C

hat was the avvillage contacts		V AC	200
between the auxiliary contacts		V AC	300
Mounting position			Vertical and 90° in all directions  With XFI earth-fault release: - NZM1, N1, NZM2, N2: vertical and 90° in all directions with plug-in unit - NZM1, N1, NZM2, N2: vertical, 90° right/left with withdrawable unit: - NZM3, N3: vertical, 90° right/left with remote operator: - NZM4, N4: vertical with remote operator: - NZM4, N(S)4: vertical and 90° in all directions
Direction of incoming supply			as required
Degree of protection			
Device			In the operating controls area: IP20 (basic degree of protection)
Enclosures			With insulating surround: IP40 With door coupling rotary handle: IP66
Terminations			Tunnel terminal: IP10 Phase isolator and strip terminal: IP00
Other technical data (sheet catalogue)			Temperature dependency, Derating
Circuit-breakers	1 -1	Α	40
Rated current = rated uninterrupted current	$I_n = I_u$	А	40
Rated surge voltage invariability	U <sub>imp</sub>	.,	2000
Main contacts		V	6000
Auxiliary contacts		V	6000
Rated operational voltage	U <sub>e</sub>	V AC	690
Overvoltage category/pollution degree		.,	III/3
Rated insulation voltage	Ui	V	690
Use in unearthed supply systems  Switching capacity		V	≦ 690
Rated short-circuit making capacity	I <sub>cm</sub>		
240 V	I <sub>cm</sub>	kA	187
400/415 V	I <sub>cm</sub>	kA	105
440 V 50/60 Hz			74
	I <sub>cm</sub>	kA	
525 V 50/60 Hz	I <sub>cm</sub>	kA	40
690 V 50/60 H	lc	kA	17
Rated short-circuit breaking capacity I <sub>cn</sub>	I <sub>cn</sub>		
Icu to IEC/EN 60947 test cycle 0-t-C0	lcu	kA	05
240 V 50/60 Hz	I <sub>cu</sub>	kA	85
400/415 V 50/60 Hz	I <sub>cu</sub>	kA	50
440 V 50/60 Hz	I <sub>cu</sub>	kA	35
525 V 50/60 Hz	I <sub>cu</sub>	kA	20
690 V 50/60 Hz	I <sub>cu</sub>	kA	10
Ics to IEC/EN 60947 test cycle 0-t-C0-t-C0	Ics	kA	
240 V 50/60 Hz	I <sub>cs</sub>	kA	85
400/415 V 50/60 Hz	I <sub>cs</sub>	kA	50
440 V 50/60 Hz	I <sub>cs</sub>	kA	35
525 V 50/60 Hz	I <sub>cs</sub>	kA	10
690 V 50/60 Hz	I <sub>cs</sub>	kA	7.5  Maximum back-up fuse, if the expected short-circuit currents at the installation
1000			location exceed the switching capacity of the circuit-breaker.
Utilization category to IEC/EN 60947-2	•		A
Lifespan, mechanical(of which max. 50 % trip by shunt/undervoltage release)	Operations		20000
Lifespan, electrical			
AC-1	0		1000
400 V 50/60 Hz	Operations		10000
415 V 50/60 Hz	Operations		10000

690 V 50/60 Hz	Operations		7500
Max. operating frequency		Ops/h	120
Total break time at short-circuit		ms	< 10
Terminal capacity			
Standard equipment			Box terminal
Optional accessories			Screw connection Tunnel terminal connection on rear
Round copper conductor			
Box terminal			
Solid		mm <sup>2</sup>	1 x (10 - 16) 2 x (6 - 16)
Stranded		mm <sup>2</sup>	$1 \times (10 - 70)^{3}$ $2 \times (6-25)$ 3) Up to 95 mm <sup>2</sup> can be connected depending on the cable manufacturer.
Tunnel terminal			,
Solid		mm <sup>2</sup>	1 x 16
Stranded		111111	
1-hole		2	1 x (25 - 95)
		mm <sup>2</sup>	1 A 120 001
Bolt terminal and rear-side connection			
Direct on the switch			4 40 40
Solid		mm <sup>2</sup>	1 x (10 - 16) 2 x (6 - 16)
Stranded		mm <sup>2</sup>	1 x (10 - 70) <sup>3)</sup> 2 x 25
			<sup>3)</sup> Up to 95 mm <sup>2</sup> can be connected depending on the cable manufacturer.
Al circular conductor			
Tunnel terminal			
Solid		$\mathrm{mm}^2$	1 x 16
Stranded			
Stranded		mm <sup>2</sup>	1 x (25 - 95)
Bolt terminal and rear-side connection			
Direct on the switch			
Solid		mm <sup>2</sup>	1 x (10 - 16) 2 x (10 - 16)
Stranded		mm <sup>2</sup>	1 x (25 - 35) 2 x (25 - 35)
Cu strip (number of segments x width x segment thickness)			
Box terminal			
	min.	mm	2 x 9 x 0.8
	max.	mm	9 x 9 x 0.8
Copper busbar (width x thickness)	mm		
Bolt terminal and rear-side connection			
Screw connection			M6
Direct on the switch			
	min.	mm	12 x 5
	max.	mm	16 x 5
Control cables			
		mm <sup>2</sup>	1 x (0.75 - 2.5) 2 x (0.75 - 1.5)

## Design verification as per IEC/EN 61439

Technical data for design verification			
Rated operational current for specified heat dissipation	In	Α	40
Equipment heat dissipation, current-dependent	P <sub>vid</sub>	W	10.66
Operating ambient temperature min.		°C	-25
Operating ambient temperature max.		°C	70
IEC/EN 61439 design verification			

10.2 Strength of materials and parts	
10.2.2 Corrosion resistance	Meets the product standard's requirements.
10.2.3.1 Verification of thermal stability of enclosures	Meets the product standard's requirements.
10.2.3.2 Verification of resistance of insulating materials to normal heat	Meets the product standard's requirements.
10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects	Meets the product standard's requirements.
10.2.4 Resistance to ultra-violet (UV) radiation	Meets the product standard's requirements.
10.2.5 Lifting	Does not apply, since the entire switchgear needs to be evaluated.
10.2.6 Mechanical impact	Does not apply, since the entire switchgear needs to be evaluated.
10.2.7 Inscriptions	Meets the product standard's requirements.
10.3 Degree of protection of ASSEMBLIES	Does not apply, since the entire switchgear needs to be evaluated.
10.4 Clearances and creepage distances	Meets the product standard's requirements.
10.5 Protection against electric shock	Does not apply, since the entire switchgear needs to be evaluated.
10.6 Incorporation of switching devices and components	Does not apply, since the entire switchgear needs to be evaluated.
10.7 Internal electrical circuits and connections	Is the panel builder's responsibility.
10.8 Connections for external conductors	Is the panel builder's responsibility.
0.9 Insulation properties	
10.9.2 Power-frequency electric strength	Is the panel builder's responsibility.
10.9.3 Impulse withstand voltage	Is the panel builder's responsibility.
10.9.4 Testing of enclosures made of insulating material	Is the panel builder's responsibility.
10.10 Temperature rise	The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices.
10.11 Short-circuit rating	Is the panel builder's responsibility. The specifications for the switchgear mus observed.
10.12 Electromagnetic compatibility	Is the panel builder's responsibility. The specifications for the switchgear mus observed.
10.13 Mechanical function	The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.


#### **Technical data ETIM 7.0**


Low-voltage industrial components (EG000017) / Power circuit-breaker for trafo/generator/installation protection (EC000228)


Electric engineering, automation, process control engineering / Low-voltage switch technology / Circuit breaker (LV < 1 kV) / Circuit breaker for power transformer, generator and system protection (ecl@ss10.0.1-27-37-04-09 [AJZ716013])

Rated permanent current lu Rated voltage Rated voltage Rated short-circuit breaking capacity lcu at 400 V, 50 Hz Rated short-circuit breaking capacity lcu at 400 V, 50 Hz Rated short-circuit breaking capacity lcu at 400 V, 50 Hz Rated short-circuit breaking capacity lcu at 400 V, 50 Hz Rated short-circuit breaking capacity lcu at 400 V, 50 Hz Rated short-circuit breaking capacity lcu at 400 V, 50 Hz Rated short-circuit release Rate Short Rated short-circuit release Rated short-circuit release Rate Short Rated short-circuit release Rated short-circuit release Rate Short Rated short-circuit release Rated short-circuit release Rate Short Rated short-circuit release Rated Short Rated Shor	protection (ecl@ss10.0.1-27-37-04-09 [AJZ716013])		
Rated short-circuit breaking capacity Icu at 400 V, 50 Hz  Norload release current setting  Adjustment range short-term delayed short-circuit release  Adjustment range undelayed short-circuit release  Adjustment range undelayed short-circuit release  AB - 10  Integrated earth fault protection  Type of electrical connection of main circuit  Device construction  Suitable for DIN rail (top hat rail) mounting  DIN rail (top hat rail) mounting optional  No  No  No  No  No  No  No  No  No  N	Rated permanent current lu	Α	40
Overload release current setting Adjustment range short-term delayed short-circuit release Adjustment range undelayed short-circuit release Adjustment range undelayed short-circuit release Adjustment range undelayed short-circuit release AB-10  Integrated earth fault protection Type of electrical connection of main circuit  Device construction Built-in device fixed built-in technique  No  DIN rail (top hat rail) mounting DIN rail (top hat rail) mounting optional  Number of auxiliary contacts as normally closed contact  Number of auxiliary contacts as normally open contact  Number of auxiliary contacts as change-over contact  No  No  No  No  No  No  No  No  No  N	Rated voltage	V	690 - 690
Adjustment range short-term delayed short-circuit release Adjustment range undelayed short-circuit release A 8 - 10  Integrated earth fault protection Type of electrical connection of main circuit Device construction Suitable for DIN rail (top hat rail) mounting DIN rail (top hat rail) mounting optional Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally open contact Number of auxiliary contacts as change-over contact With switched-off indicator With under voltage release  A 0 - 0  Rail (0 - 0  No  Frame clamp  No  Built-in device fixed built-in technique  No  Ves  0  0  0  0  No  No  No  No  No  No  No	Rated short-circuit breaking capacity Icu at 400 V, 50 Hz	kA	50
Adjustment range undelayed short-circuit release A 8 - 10 Integrated earth fault protection No Type of electrical connection of main circuit Type of electrical connection of main circuit Device construction Suitable for DIN rail (top hat rail) mounting DIN rail (top hat rail) mounting Ves No DIN rail (top hat rail) mounting optional Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally open contact  Number of auxiliary contacts as change-over contact With switched-off indicator With under voltage release  A 8 - 10 No  Rail (top hat rail) mounting Built-in device fixed built-in technique No  O  O  O  O  O  No  With switched-off indicator No  No  No	Overload release current setting	А	32 - 40
Integrated earth fault protection Type of electrical connection of main circuit Frame clamp Device construction Built-in device fixed built-in technique Suitable for DIN rail (top hat rail) mounting No DIN rail (top hat rail) mounting optional Yes Number of auxiliary contacts as normally closed contact 0 Number of auxiliary contacts as normally open contact 0 Number of auxiliary contacts as change-over contact 0 With switched-off indicator No With under voltage release No	Adjustment range short-term delayed short-circuit release	А	0 - 0
Type of electrical connection of main circuit  Device construction  Suitable for DIN rail (top hat rail) mounting  DIN rail (top hat rail) mounting optional  No  DIN rail (top hat rail) mounting optional  Number of auxiliary contacts as normally closed contact  Number of auxiliary contacts as normally open contact  Number of auxiliary contacts as change-over contact  With switched-off indicator  With under voltage release  Frame clamp  Built-in device fixed built-in technique  No  No  No  No  No  No  No  No  No  N	Adjustment range undelayed short-circuit release	А	8 - 10
Device construction  Suitable for DIN rail (top hat rail) mounting  DIN rail (top hat rail) mounting optional  No  DIN rail (top hat rail) mounting optional  Number of auxiliary contacts as normally closed contact  Number of auxiliary contacts as normally open contact  Number of auxiliary contacts as change-over contact  O  With switched-off indicator  With under voltage release  Built-in device fixed built-in technique  No  Yes  0  0  No  No  No  No  No	Integrated earth fault protection		No
Suitable for DIN rail (top hat rail) mounting DIN rail (top hat rail) mounting optional Yes  Number of auxiliary contacts as normally closed contact 0  Number of auxiliary contacts as normally open contact 0  Number of auxiliary contacts as change-over contact 0  With switched-off indicator No  With under voltage release No	Type of electrical connection of main circuit		Frame clamp
DIN rail (top hat rail) mounting optional  Number of auxiliary contacts as normally closed contact  Number of auxiliary contacts as normally open contact  Number of auxiliary contacts as change-over contact  O  With switched-off indicator  With under voltage release  No	Device construction		Built-in device fixed built-in technique
Number of auxiliary contacts as normally closed contact  0  Number of auxiliary contacts as normally open contact  0  Number of auxiliary contacts as change-over contact  0  With switched-off indicator  No  With under voltage release  No	Suitable for DIN rail (top hat rail) mounting		No
Number of auxiliary contacts as normally open contact  Number of auxiliary contacts as change-over contact  O  With switched-off indicator  With under voltage release  No	DIN rail (top hat rail) mounting optional		Yes
Number of auxiliary contacts as change-over contact  0  With switched-off indicator  No  With under voltage release  No	Number of auxiliary contacts as normally closed contact		0
With switched-off indicator No With under voltage release No	Number of auxiliary contacts as normally open contact		0
With under voltage release No	Number of auxiliary contacts as change-over contact		0
	With switched-off indicator		No
Number of poles 4	With under voltage release		No
	Number of poles		4
Position of connection for main current circuit Front side	Position of connection for main current circuit		Front side
Type of control element Rocker lever	Type of control element		Rocker lever
Complete device with protection unit  Yes	Complete device with protection unit		Yes
Motor drive integrated No	Motor drive integrated		No
Motor drive optional No	Motor drive optional		No
Degree of protection (IP)	Degree of protection (IP)		IP20


#### **Characteristics**

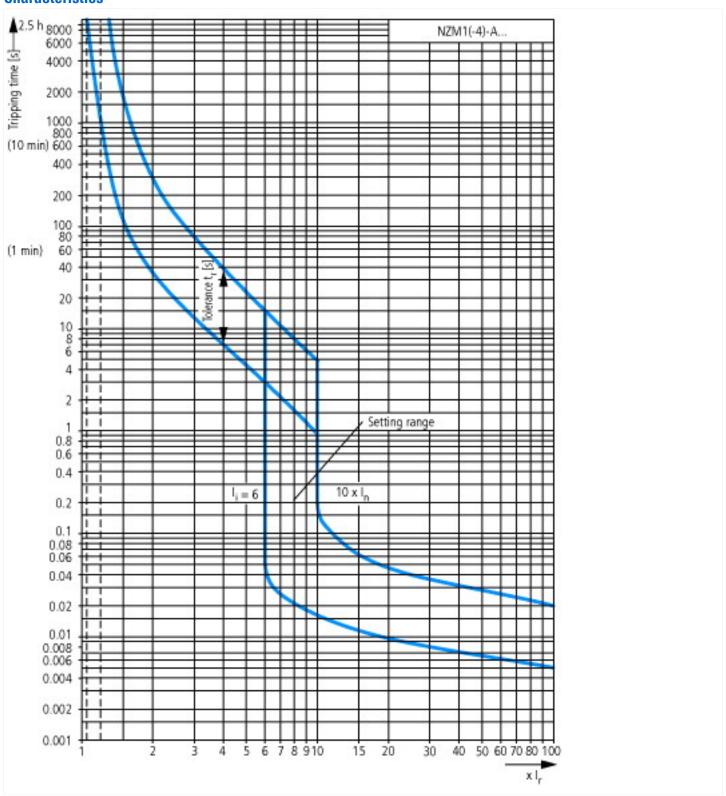


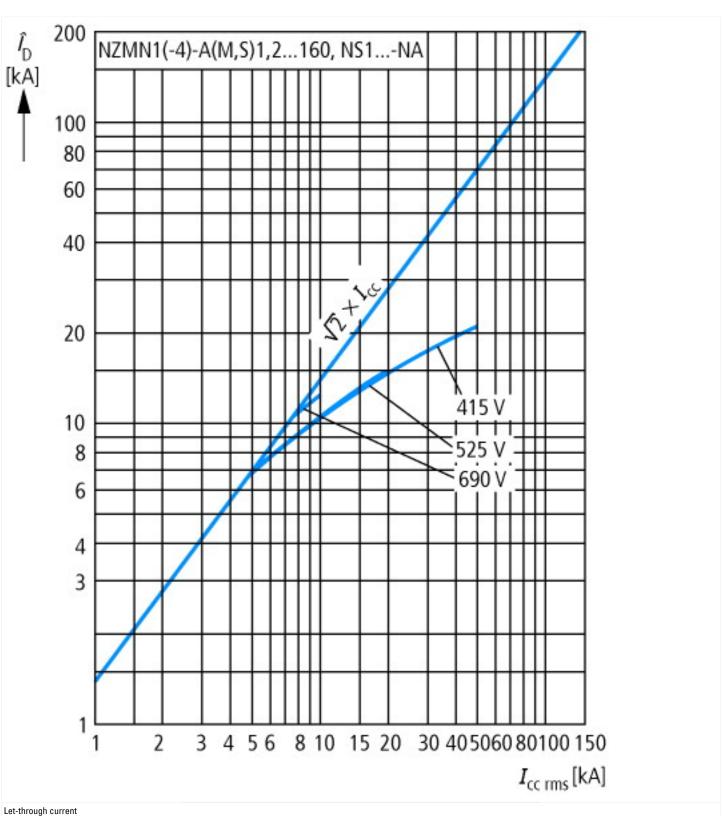

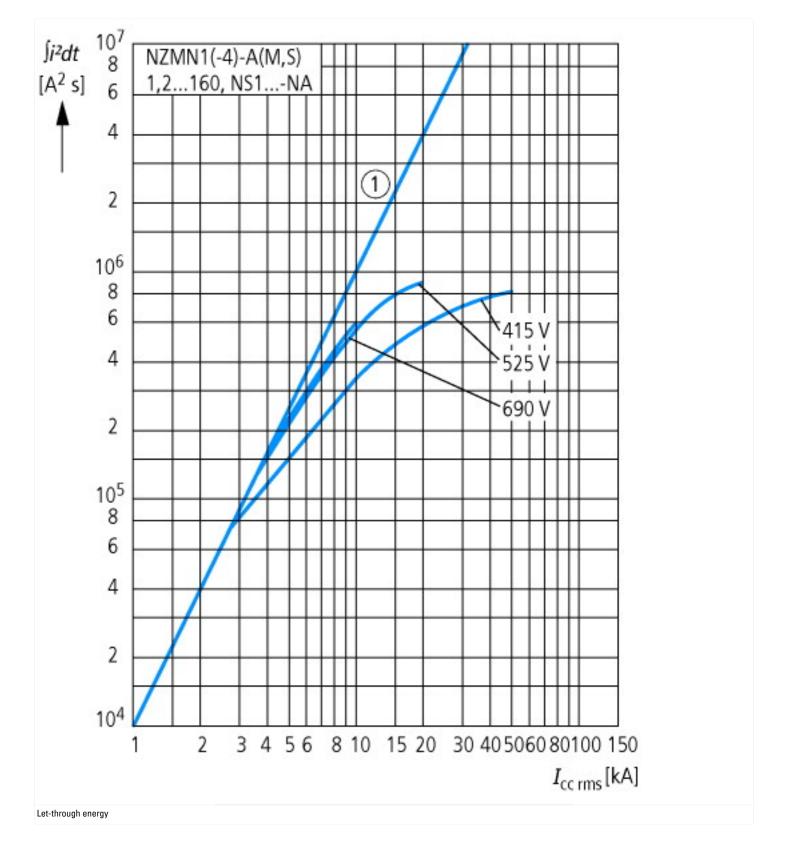

## **Dimensions**

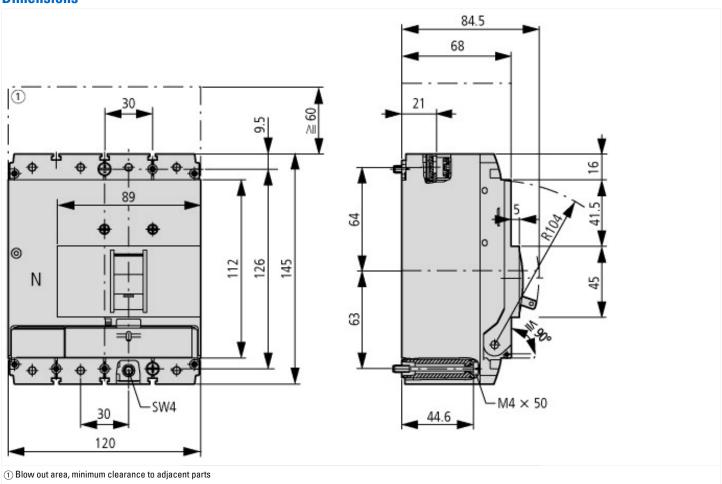

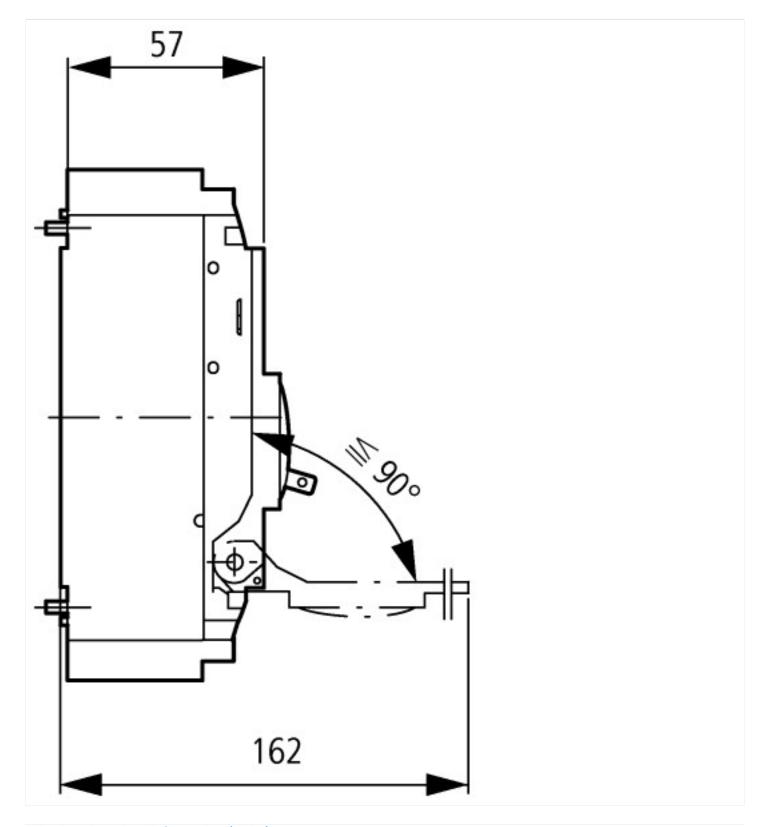

# Additional product information (links)

IL01203004Z (AWA1230-1913) Circuit-breaker, Switch-Disconnector		
IL01203004Z (AWA1230-1913) Circuit-breaker, Switch-Disconnector	ftp://ftp.moeller.net/DOCUMENTATION/AWA_INSTRUCTIONS/IL01203004Z2015_11.pdf	
Temperature dependency, Derating	http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.172	
CurveSelect characteristics program	http://www.eaton.eu/DE/Europe/Electrical/CustomerSupport/ConfigurationTools/CharacteristicsProgram/index.htm	
additional technical information for NZM power switch	ftp://ftp.moeller.net/DOCUMENTATION/PDF/nzm_technic_de_en.pdf	