DATASHEET - NZMN2-VE160



Circuit-breaker, 3p, 160A

Part no. NZMN2-VE160 Catalog No. 259123

EL-Nummer (Norway)

0004315541



Similar to illustration

Delivery program

Product range			Circuit-breaker
Protective function			Systems, cable, selectivity and generator protection
Standard/Approval			IEC
Installation type			Fixed
Release system			Electronic release
Construction size			NZM2
Description			R.m.s. value measurement and "thermal memory" Adjustable time delay setting to overcome current peaks tr at 6 x Ir also infinity (without overload releases) Adjustable delay time tsd $\rm i^2t$ constant function: fixed OFF
Number of poles			3 pole
Standard equipment			Screw connection
Switching capacity			
400/415 V 50 Hz	I _{cu}	kA	50
Rated current = rated uninterrupted current			

Setting range

Rated current = rated uninterrupted current

Overload	trip



Short-circuit releases



Non-delay	ec
-----------	----



Delayed

 $I_n = I_u$





Α

Α

160

80 - 160

1920 A fixed

2 - 10

Technical data

		IEC/EN 60947
		Finger and back of hand proof to VDE 0106 Part 100
		Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30
c	°C	- 40 - + 70
c	°C	-25 - +70
(g	20 (half-sinusoidal shock 20 ms)
\	V AC	500
\	V AC	300
ŀ	kg	2.345
		°C °C g VAC VAC

Mounting position Direction of incoming supply			Vertical and 90° in all directions 90° 90° 90°	With XFI earth-fault release: - NZM1, N1, NZM2, N2: vertical and 90° in all directions with plug-in unit - NZM1, N1, NZM2, N2: vertical, 90° right/left with withdrawable unit: - NZM3, N3: vertical, 90° right/left - NZM4, N4: vertical with remote operator: - NZM2, N(S)2, NZM3, N(S)3, NZM4, N(S)4: vertical and 90° in all directions
			as required	
Degree of protection			lul di ul IBB	
Device			In the operating controls area: IP2	to (basic degree of protection)
Enclosures Terminations			With insulating surround: IP40 With door coupling rotary handle: Tunnel terminal: IP10 Phase isolator and strip terminal:	
Other technical data (sheet catalogue)			Temperature dependency, Deratin	ng
Circuit-breakers				
Rated current = rated uninterrupted current	$I_n = I_u$	Α	160	
Rated surge voltage invariability	U _{imp}			
Main contacts		V	8000	
Auxiliary contacts		V	6000	
Rated operational voltage	U _e	V AC	690	
Overvoltage category/pollution degree			III/3	
Rated insulation voltage	Ui	V	1000	
Use in unearthed supply systems		V	≦ 690	
Switching capacity Rated short-circuit making capacity	I _{cm}			
240 V	I _{cm}	kA	187	
400/415 V	I _{cm}	kA	105	
440 V 50/60 Hz	I _{cm}	kA	74	
525 V 50/60 Hz		kA	53	
690 V 50/60 H	I _{cm}	kA	40	
Rated short-circuit breaking capacity I _{cn}	I _{cn}	KA.	то	
Icu to IEC/EN 60947 test cycle 0-t-C0	Icu	kA		
240 V 50/60 Hz	I _{cu}	kA	85	
400/415 V 50/60 Hz	I _{cu}	kA	50	
440 V 50/60 Hz		kA	35	
525 V 50/60 Hz	I _{cu}		25	
690 V 50/60 Hz	I _{cu}	kA kA	20	
lcs to IEC/EN 60947 test cycle O-t-CO-t-CO	I _{cu}	kA	20	
240 V 50/60 Hz	lcs	kA	85	
400/415 V 50/60 Hz	I _{cs}	kA	50	
440 V 50/60 Hz	I _{cs}	kA	35	
525 V 50/60 Hz	I _{cs}	kA	25	
690 V 50/60 Hz	I _{cs}	kA	5	
	I _{cs}	KA		ected short-circuit currents at the installation pacity of the circuit-breaker.
Rated short-time withstand current				
t=0.3 s	I _{cw}	kA	1.9	
t=1s	I _{cw}	kA	1.9	
Utilization category to IEC/EN 60947-2			Α	
Lifespan, mechanical(of which max. 50 % trip by shunt/undervoltage release)	Operations		20000	
Lifespan, electrical				

400 V F0/00 V			40000
400 V 50/60 Hz	Operations		10000
415 V 50/60 Hz	Operations		10000
690 V 50/60 Hz	Operations		7500
AC3			
400 V 50/60 Hz	Operations		6500
415 V 50/60 Hz	Operations		6500
690 V 50/60 Hz	Operations		5000
Max. operating frequency		Ops/h	120
Total break time at short-circuit		ms	< 10
Terminal capacity			
Standard equipment			Screw connection
Optional accessories			Box terminal Tunnel terminal connection on rear
Round copper conductor			
Box terminal			
Solid		mm ²	1 x (10 - 16) 2 x (6 - 16)
Strandad		2	
Stranded		mm ²	1 x (25 - 185) 2 x (25 - 70)
Tunnel terminal Solid		2	1 x 16
		mm ²	1 X 1b
Stranded			
1-hole		mm ²	1 x (25 - 185)
Bolt terminal and rear-side connection			
Direct on the switch			
Solid		mm ²	1 x (10 - 16) 2 x (6 - 16)
Stranded		mm ²	1 x (25 - 185) 2 x (25 - 70)
Al circular conductor			
Tunnel terminal			
Solid		mm^2	1 x 16
Stranded			
Stranded		mm ²	1 x (25 - 185)
Bolt terminal and rear-side connection			
Direct on the switch			
Solid		mm ²	1 x (10 - 16) 2 x (10 - 16)
Stranded		mm ²	1 x (25 - 50)
			2 x (25 - 50)
Cu strip (number of segments x width x segment thickness)			
Box terminal			0.000
	min.	mm	2 x 9 x 0.8
	max.	mm	10 x 16 x 0.8 (2x) 8 x 15.5 x 0,8
Bolt terminal and rear-side connection			
Flat copper strip, with holes	min.	mm	2 x 16 x 0.8
Flat copper strip, with holes	max.	mm	10 x 24 x 0.8
Copper busbar (width x thickness)	mm		
Bolt terminal and rear-side connection			
Screw connection			M8
Direct on the switch			
	min.	mm	16 x 5
	max.	mm	24 x 8
Control cables			
		mm ²	1 x (0.75 - 2.5) 2 x (0.75 - 1.5)

Design verification as per IEC/EN 61439

Technical data for design verification			
Rated operational current for specified heat dissipation	In	Α	160
Equipment heat dissipation, current-dependent	P _{vid}	W	21.12
Operating ambient temperature min.		°C	-25
Operating ambient temperature max.		°C	70
IEC/EN 61439 design verification			
10.2 Strength of materials and parts			
10.2.2 Corrosion resistance			Meets the product standard's requirements.
10.2.3.1 Verification of thermal stability of enclosures			Meets the product standard's requirements.
10.2.3.2 Verification of resistance of insulating materials to normal heat			Meets the product standard's requirements.
10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects			Meets the product standard's requirements.
10.2.4 Resistance to ultra-violet (UV) radiation			Meets the product standard's requirements.
10.2.5 Lifting			Does not apply, since the entire switchgear needs to be evaluated.
10.2.6 Mechanical impact			Does not apply, since the entire switchgear needs to be evaluated.
10.2.7 Inscriptions			Meets the product standard's requirements.
10.3 Degree of protection of ASSEMBLIES			Does not apply, since the entire switchgear needs to be evaluated.
10.4 Clearances and creepage distances			Meets the product standard's requirements.
10.5 Protection against electric shock			Does not apply, since the entire switchgear needs to be evaluated.
10.6 Incorporation of switching devices and components			Does not apply, since the entire switchgear needs to be evaluated.
10.7 Internal electrical circuits and connections			Is the panel builder's responsibility.
10.8 Connections for external conductors			Is the panel builder's responsibility.
10.9 Insulation properties			
10.9.2 Power-frequency electric strength			Is the panel builder's responsibility.
10.9.3 Impulse withstand voltage			Is the panel builder's responsibility.
10.9.4 Testing of enclosures made of insulating material			Is the panel builder's responsibility.
10.10 Temperature rise			The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices.
10.11 Short-circuit rating			Is the panel builder's responsibility. The specifications for the switch gear must be observed. $\label{eq:specifications}$
10.12 Electromagnetic compatibility			Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.13 Mechanical function			The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.

Technical data ETIM 7.0


Low-voltage industrial components (EG000017) / Power circuit-breaker for trafo/generator/installation protection (EC000228)


Electric engineering, automation, process control engineering / Low-voltage switch technology / Circuit breaker (LV < 1 kV) / Circuit breaker for power transformer, generator and system protection (ecl@ss10.0.1-27-37-04-09 [AJZ716013])


protection (ecl@ss10.0.1-27-37-04-09 [AJZ716013])		
Rated permanent current lu	А	160
Rated voltage	V	690 - 690
Rated short-circuit breaking capacity Icu at 400 V, 50 Hz	kA	50
Overload release current setting	А	80 - 160
Adjustment range short-term delayed short-circuit release	А	160 - 1600
Adjustment range undelayed short-circuit release	А	1920 - 1920
Integrated earth fault protection		No
Type of electrical connection of main circuit		Screw connection
Device construction		Built-in device fixed built-in technique
Suitable for DIN rail (top hat rail) mounting		No
DIN rail (top hat rail) mounting optional		Yes
Number of auxiliary contacts as normally closed contact		0
Number of auxiliary contacts as normally open contact		0
Number of auxiliary contacts as change-over contact		0
With switched-off indicator		No
With under voltage release		No
Number of poles		3

Position of connection for main current circuit	Front side
Type of control element	Rocker lever
Complete device with protection unit	Yes
Motor drive integrated	No
Motor drive optional	Yes
Degree of protection (IP)	IP20


Characteristics

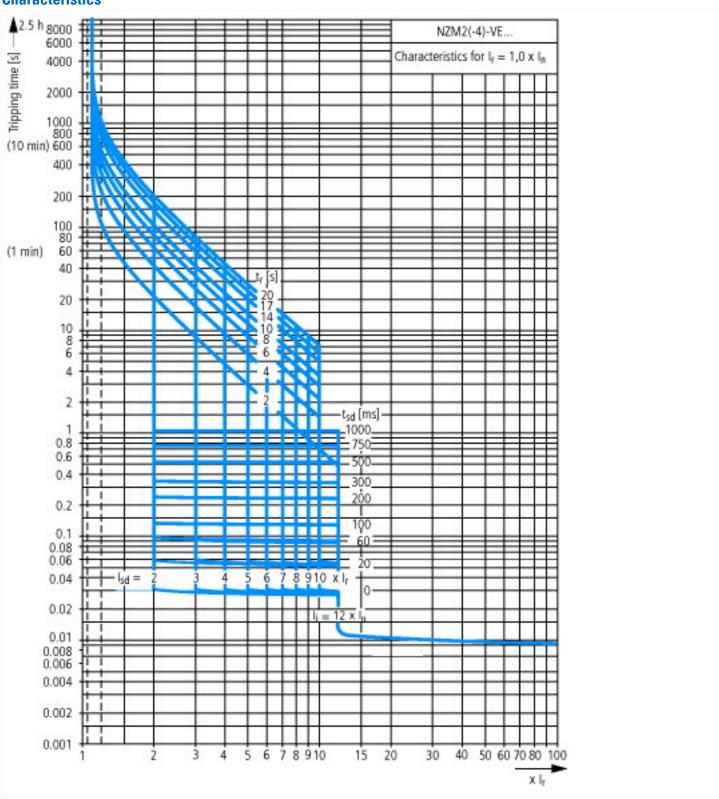

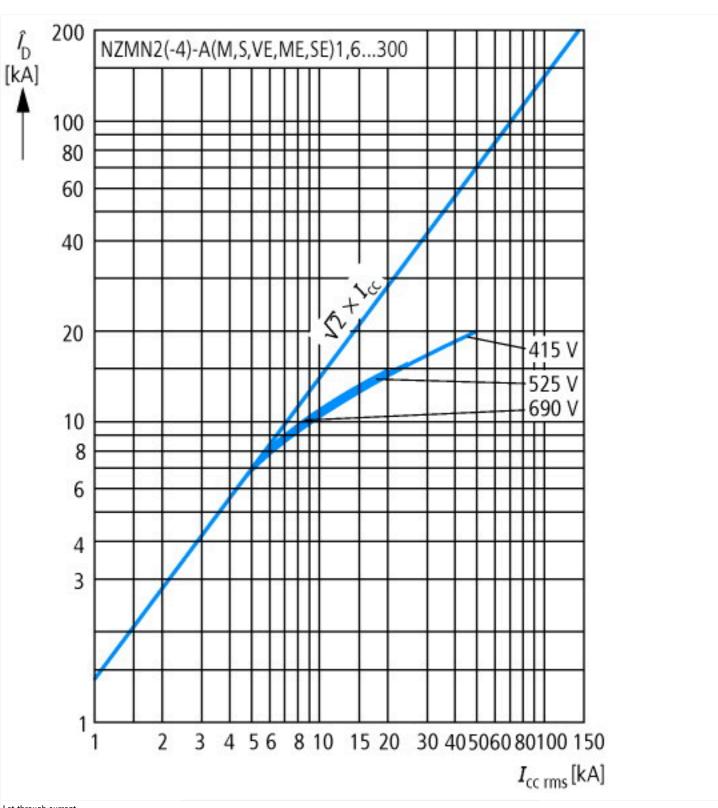


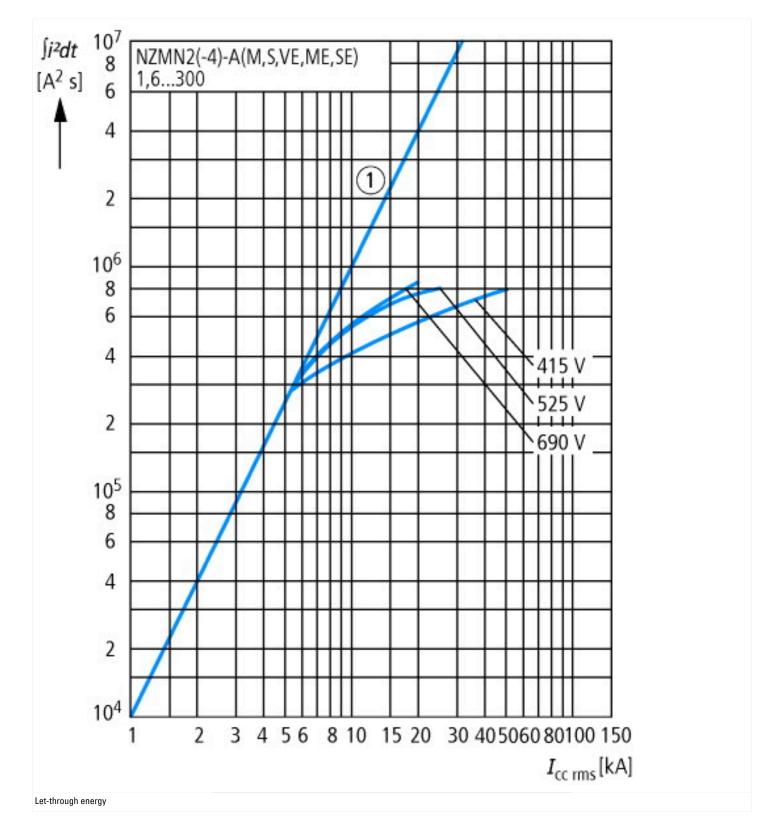

Dimensions

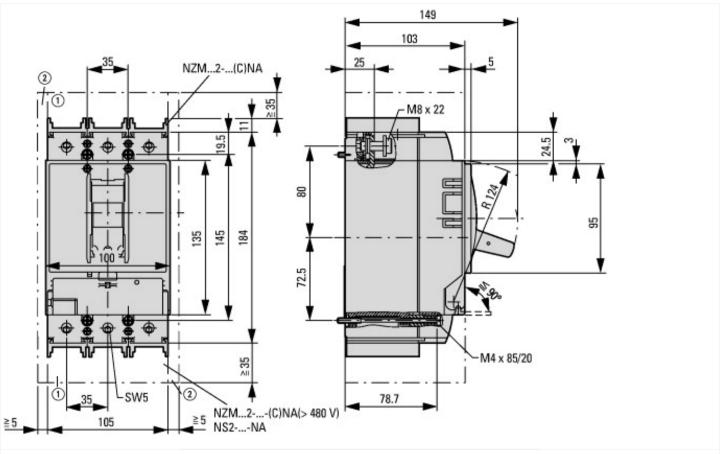

Blow out area, minimum clearance to adjacent parts
 Minimum clearance to adjacent parts

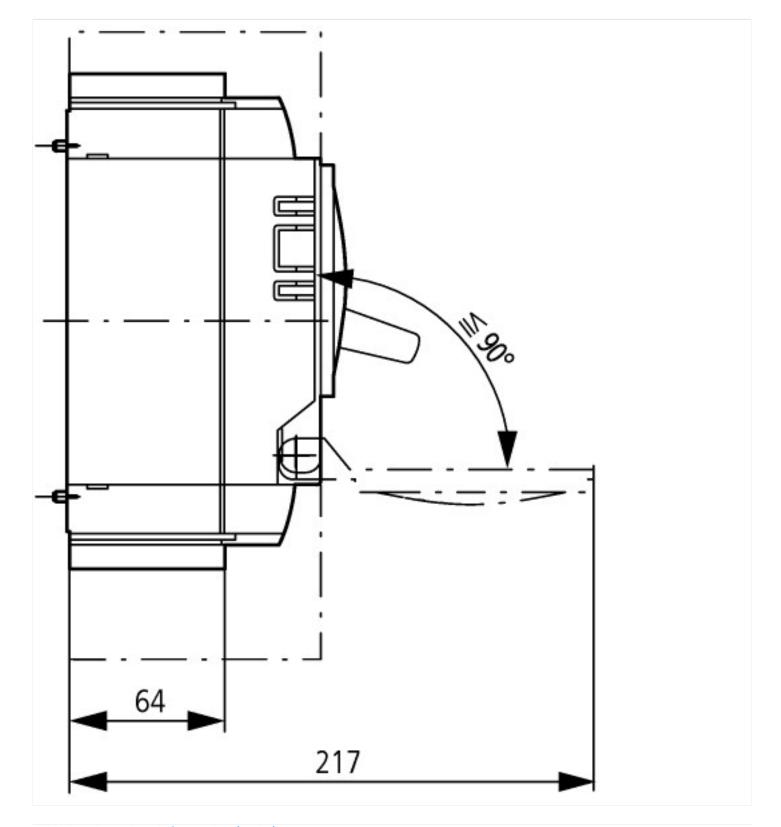

Additional product information (links)

	the state of the s				
IL01206006Z (AWA1230-1916) Circuit-Breaker, basic unit					
IL01206006Z (AWA1230-1916) Circuit-Breaker, basic unit	https://es-assets.eaton.com/DOCUMENTATION/AWA_INSTRUCTIONS/IL01206006Z2015_11.pdf				
Temperature dependency, Derating	http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.172				
CurveSelect characteristics program	http://www.eaton.eu/DE/Europe/Electrical/CustomerSupport/ConfigurationTools/CharacteristicsProgram/index.htm				
Eaton configurator	http://www.eaton.eu/DE/Europe/Electrical/CustomerSupport/ConfigurationTools/ConfiguratorCircuitBreaker/index.htm				
additional technical information for NZM power switch	https://es-assets.eaton.com/DOCUMENTATION/PDF/nzm_technic_de_en.pdf				